


Air Flow: DFC Comfort 0.15

Air flow through high impulse element

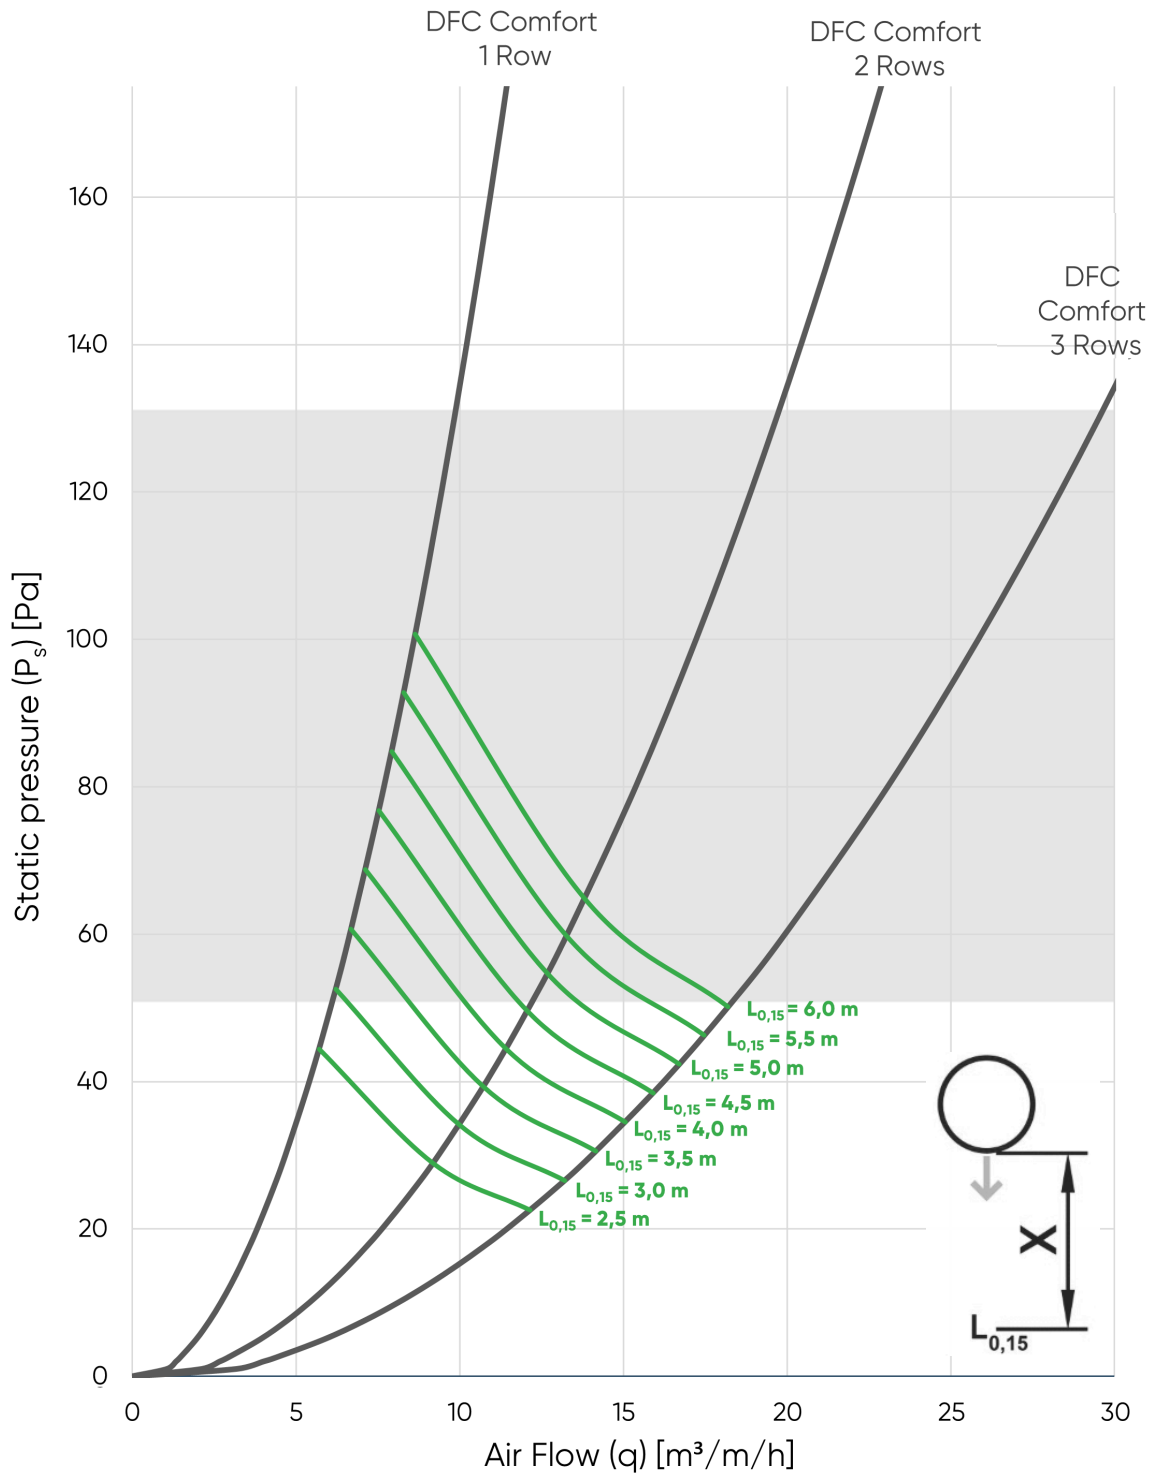

Ideal operation area
 $L_{0,15}$ is the airspeed 0,15 m/s at x metres away from the duct at Isoterm temperature