




Air Flow: DFC Long Throw 0.25

Air flow through high impulse element

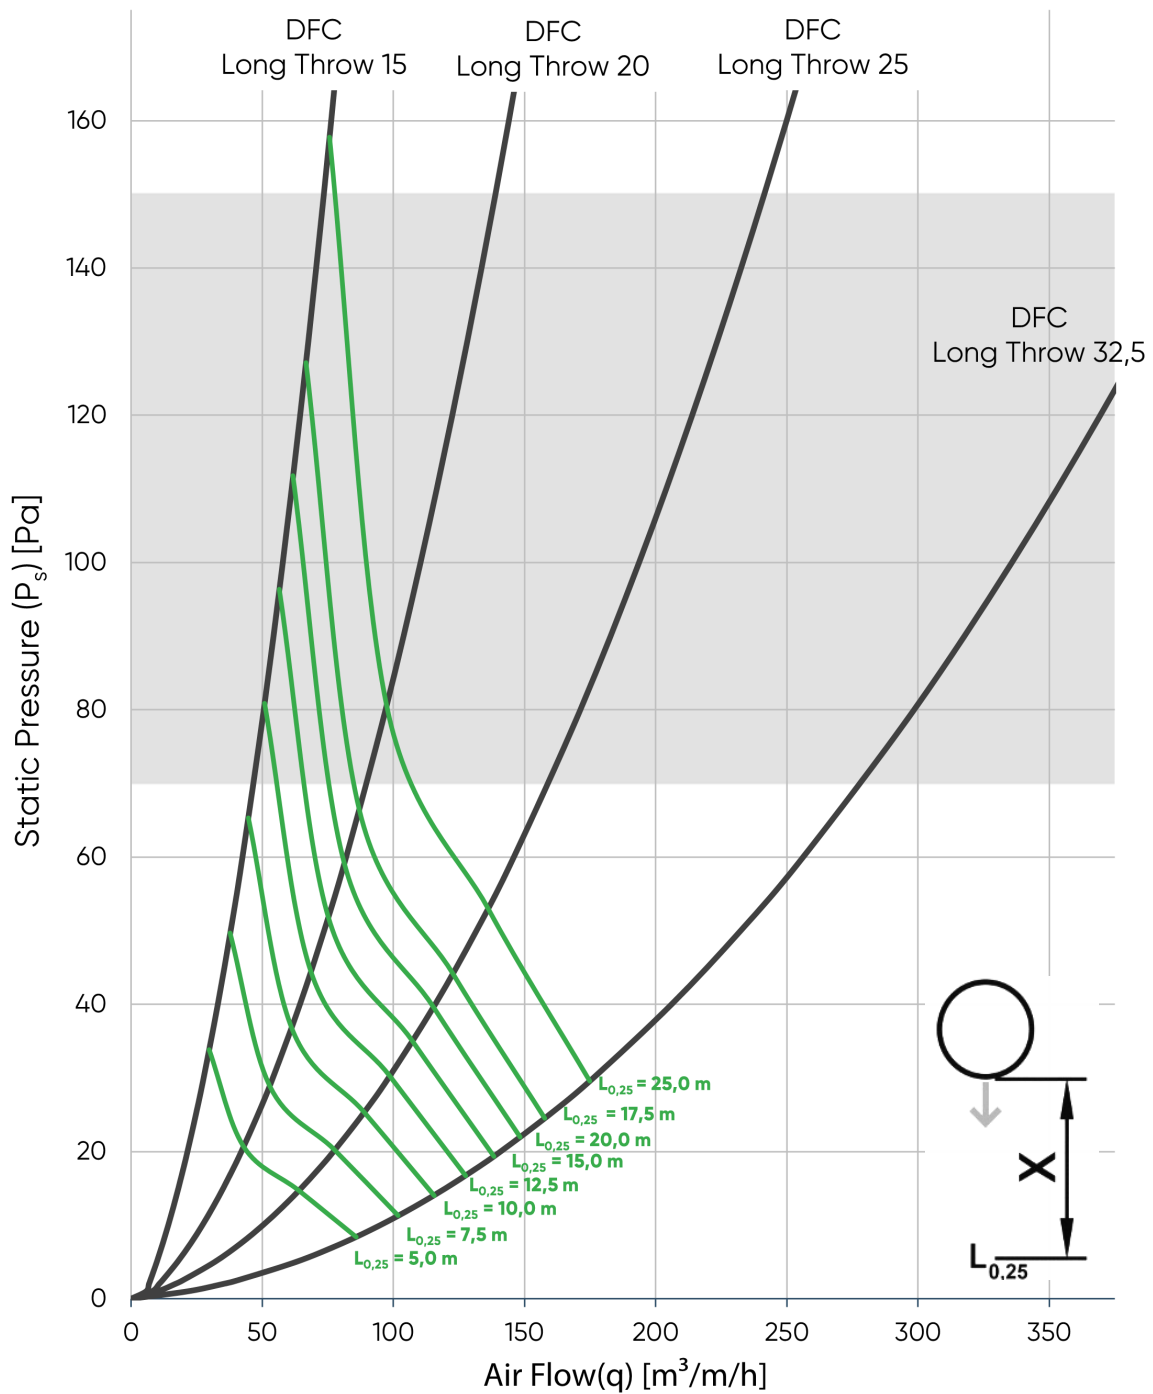

 Ideal operation area

 $L_{0,25}$ is the airspeed 0,25 m/s at x metres away from the duct at isotherm temperature