




Air Flow: DFC Long Throw 0.35

Air flow through high impulse element

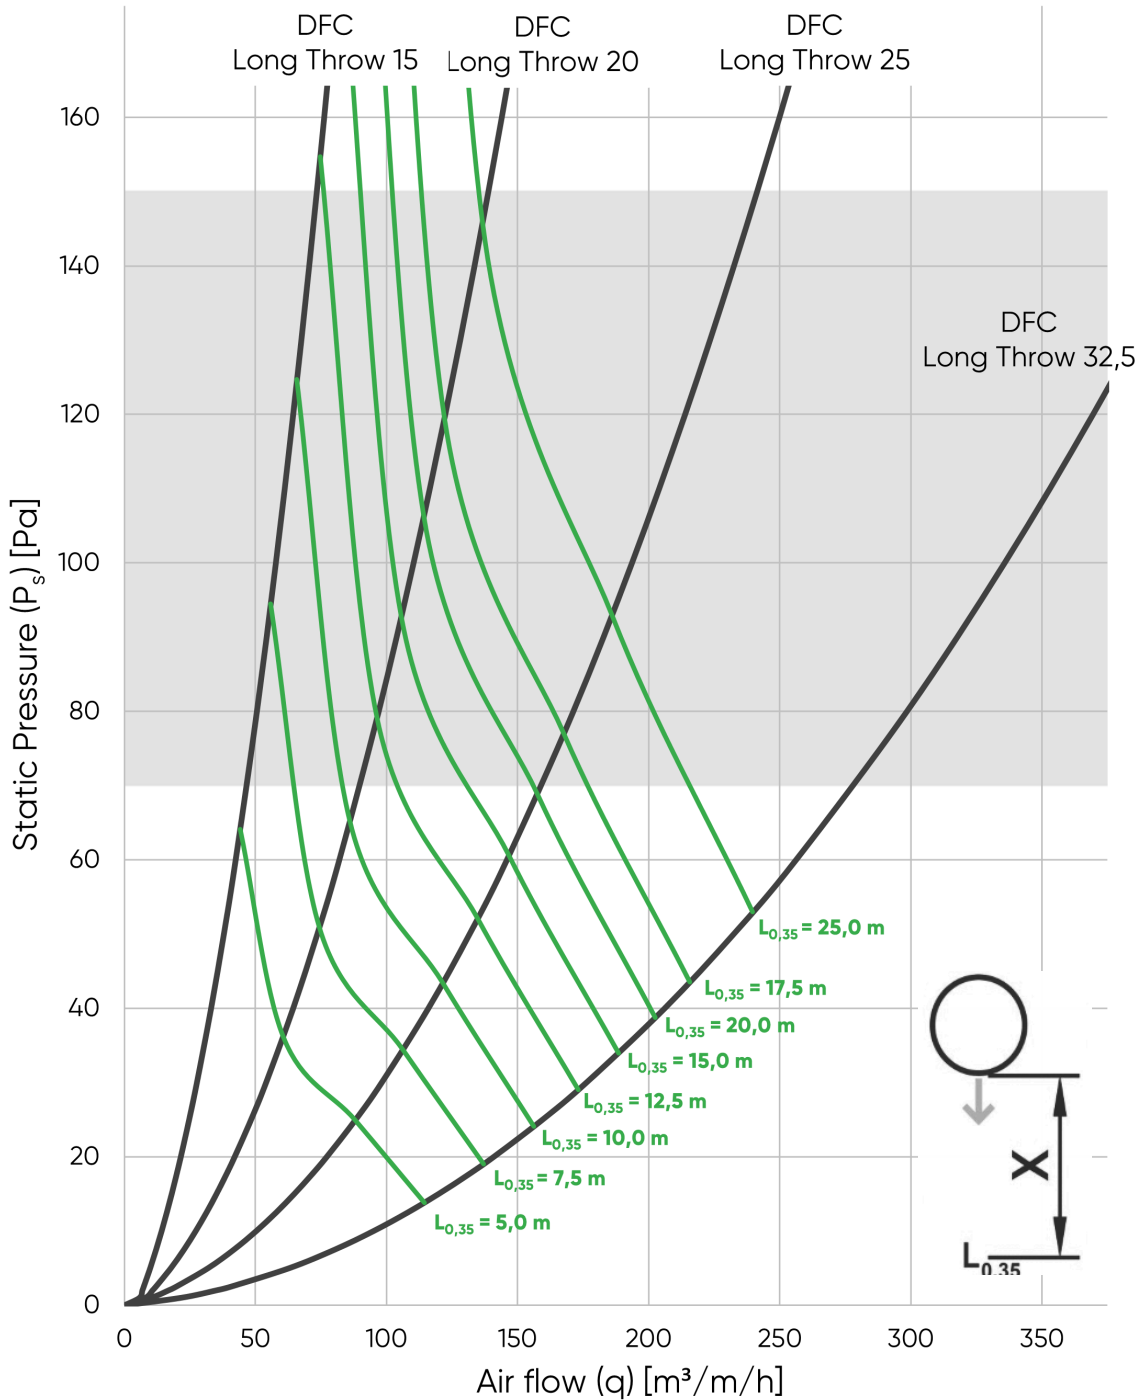

 Ideal operation area

 $L_{0,35}$ is the airspeed 0,35 m/s at x metres away from the duct at isotherm temperature